

CONFIO[®]
BINARY SENSOR
CTBSZW7

INTRODUCTION

4-Channel Binary Sensor is a Wireless Module that allows improvement of the functionality of any Wired Sensor with a binary output by adding Z-Wave Network Communication. It can service up to four Binary Sensors.

TECHNICAL SPECIFICATIONS

The specifications and permissible maximum Load ratings are tested at +25°C.

Power Input	240VAC, 50Hz
Maximum Load per Channel @240VAC	NA
CumulativeLoad - 4 Channel Muxed @240VAC	NA
Operating Temperature	-10° to +55°C
Temperature Sensing	NA
Relative Humidity	8% - 80%RH
Dimensions	49mm x 49mm x 18mm

Radio Frequency	865.2MHz (IN)
Surge Protection	1.2kv
Typical Line of Sight Range	10~15m Indoor /30m Outdoor
Plastic Housing	Fire Retardant ABS
Sensors	Motion Sensor, Door Contact, Gas Sensor, Vibration Sensor, Perimeter Sensor

WARNINGS & CONSIDERATIONS



CAUTION

READ INSTRUCTIONS IN FULL BEFORE USE

Wiring connection diagram and parameters to use are mentioned in the manual. The Manufacturer, Confio will not be held responsible for any loss or damage resulting from not following the instructions of operating manual.



CAUTION

DO NOT CONNECT THE DEVICE TO LOADS EXCEEDING RECOMMENDED VALUES

Connect Loads to the module below the Load ratings to work normally. Do not connect overload, this may lead to module failure.



CAUTION

FOLLOW INSTRUCTION MANUAL FOR CIRCUIT CONNECTION

Connections must be made according to the instructions available on Operational Manual, faulty connection leads to manual failure.



DANGER

DANGER OF ELECTRIC SHOCK

All works on the Device may be performed only by a trained Installers. If the installation is done by an unauthorized Technician the Manufacturer will not be held responsible. Contact support@confiolabs.com or call +91-9606030659 for a list of authorized Technicians.



DANGER

DANGER OF ELECTRIC SHOCK

Any works introducing changes into the configuration of connections or the load must be always performed with disconnected voltage. Since there are high chances of voltage occurrence at the terminals even after Device turn off. (Turn off the MCB).



DANGER

DANGER OF ELECTRIC SHOCK


Faulty connection or use may result in fire or Electric Shock.

SAFETY MEASURES

- Before installation, make sure that the power supply mains is turned off.
- Remove the switchboard cover frame and the switch frame to access the switches.
- Use only minimum 1.5mm² wires and maximum 2.5mm² wires for connections.
- This Device requires a neutral lead to operate.

CIRCUIT CONNECTIONS

The below wiring diagrams explain the possible combinations that are available.

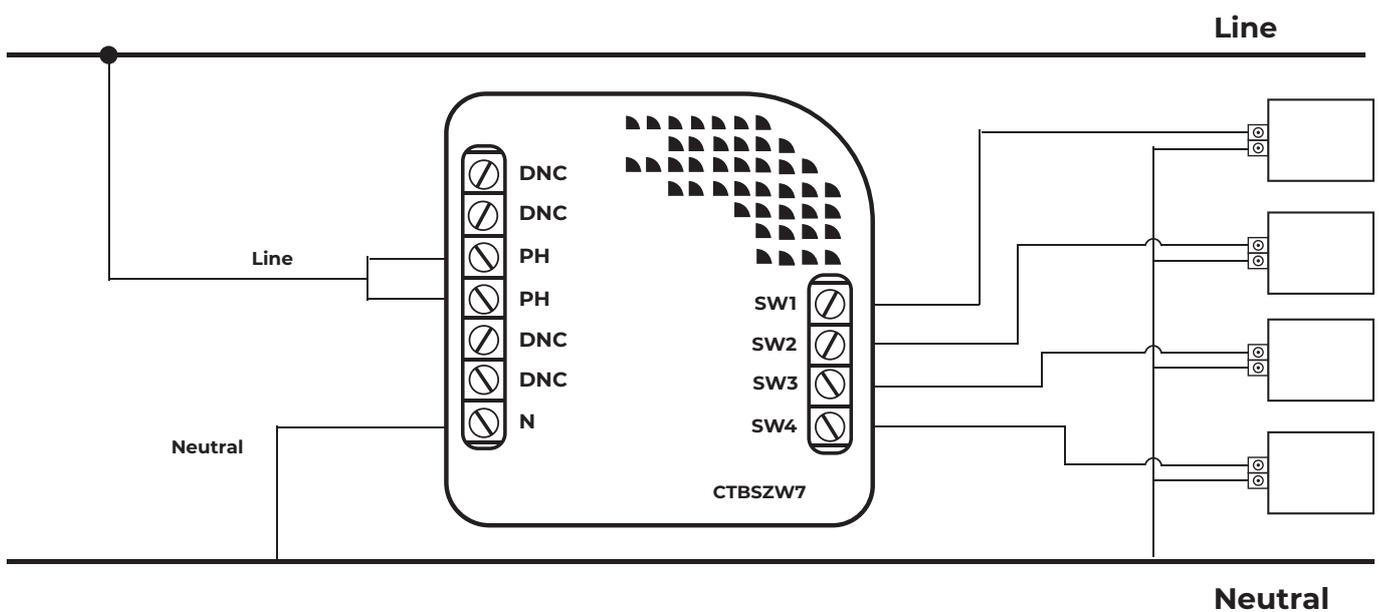

NOTE: The Manufacturer, Confio will not be held responsible for any loss or damage resulting from not following the instructions of the Operating Manual.

ACTIVATING BINARY

1. Installing the Device

- Make sure that the power supply mains is turned off.
- Connect the device to the wiring diagram.
- Connect the Phase, Neutral and the Sensors on SW1, SW2, SW3, SW4.
- Complete all the connections and check the pairing before sealing the Electrical Box.

2. Managing the Device through Z-Wave Network

It is recommended to place the micro module within 3 meters Line of Sight, as adding mode requires direct communication with the Controller. Move the Module near to the Primary Controller during this step, if required.

INCLUSION METHODS

Method 1

Press the Node ID button (at the back of the Module), to start pairing the device to the Gateway.

EXCLUSION METHODS

Method 1

Press the Node ID Button (at the back of the Module), to start the Exclusion process from the Gateway

LED INDICATIONS

LED Indication	Status
Red Blinking	Excluded
Green Blinking	Included/Paired
Red and Green	In Pairing Mode

RESETTING DEVICE

For resetting the Micro Module, press and hold the Node ID button behind the Module for 10seconds. Then the Device will be restored to it's default settings.

SETTING ADDITIONAL PARAMETERS

- Log on to Z-Wave Gateway from app.
- Click Device Options >> Add Configuration Settings.
- Enter the Parameter Number in the Variable Box and enter the desired Parameter Value.
- Click "SET".
- Close the dialog box and click Update Button.

IMPORTANT INSTRUCTIONS

- Wear standard personal protection equipment to give protection to the Installer.
- Position the antenna far away from metal elements to avoid interference.
- Do not cut or shorten the antenna, as its length is matched to the band in which the system operates.
- Do not over-tighten the terminal block. It can cause serious malfunctioning after Installation.

ADDITIONAL PARAMETERS

Parameter 01	Binary Sensor state for Channel1.
Range	0 to 1 0: INPUT_NO (Normal Open) 1: INPUT_NC (Normal Close)
Default	0: INPUT_NO (Normal Open)
Description	This parameter decides the Input type.

Parameter 02	Binary Sensor state for Channel2.
Range	0 to 1 0: INPUT_NO (Normal Open) 1: INPUT_NC (Normal Close)
Default	0: INPUT_NO (Normal Open)
Description	This parameter decides the Input type.

Parameter 03
Range

Binary Sensor state for Channel3.
0 to 1

0: INPUT_NO (Normal Open)
1: INPUT_NC (Normal Close)

Default
Description

0: INPUT_NO (Normal Open)
This parameter decides the Input type.

Parameter 04
Range

Binary Sensor state for Channel4.
0 to 1

0: INPUT_NO (Normal Open)
1: INPUT_NC (Normal Close)

Default
Description

0: INPUT_NO (Normal Open)
This parameter decides the Input type.

RECOMMENDATIONS

- Inclusion has to be done within 3 meters.
- If there are signs of water seeping into the Electrical Box, turn off the MCB and disconnect the power supply to avoid short circuits.
- Strictly follow the wiring diagram for connections.

COMMON ISSUES

Pairing not Working: Confirm that the Gateway and the Curtain Controller are within 3 meters from each other while adding to the Gateway.

WARRANTY

A Standard warranty of 24 months from the date of supply is applicable for all products

The warranty shall not cover:

- Mechanical damages caused by impact, falling or dropping the device or their object, unauthorized use or not observing the Operation Manual.
- Damages resulting from external causes, for example, flood, storm, fire, lightning, natural disasters.
- Damages resulting from surges in the power and/or telecommunication network, improper connection to the grid in a manner inconsistent with the operating manual, or from connecting other Devices not recommended by the Manufacturer.
- Damages resulting from the use of spurious spare parts or accessories improper for given model, repairing and introducing alterations by unauthorized persons.
- Defects caused by operating inoperable devices or accessories.

MEDHA

By Confio

For any technical and support queries,
please contact the Manufacturer

CONFIO TECHNOLOGIES PRIVATE LIMITED
#3500/A, 80 Feet Road,
Raghuvanahalli, Bangalore - 560062
Karnataka, India

Email: support@confiolabs.com
www.confiolabs.com